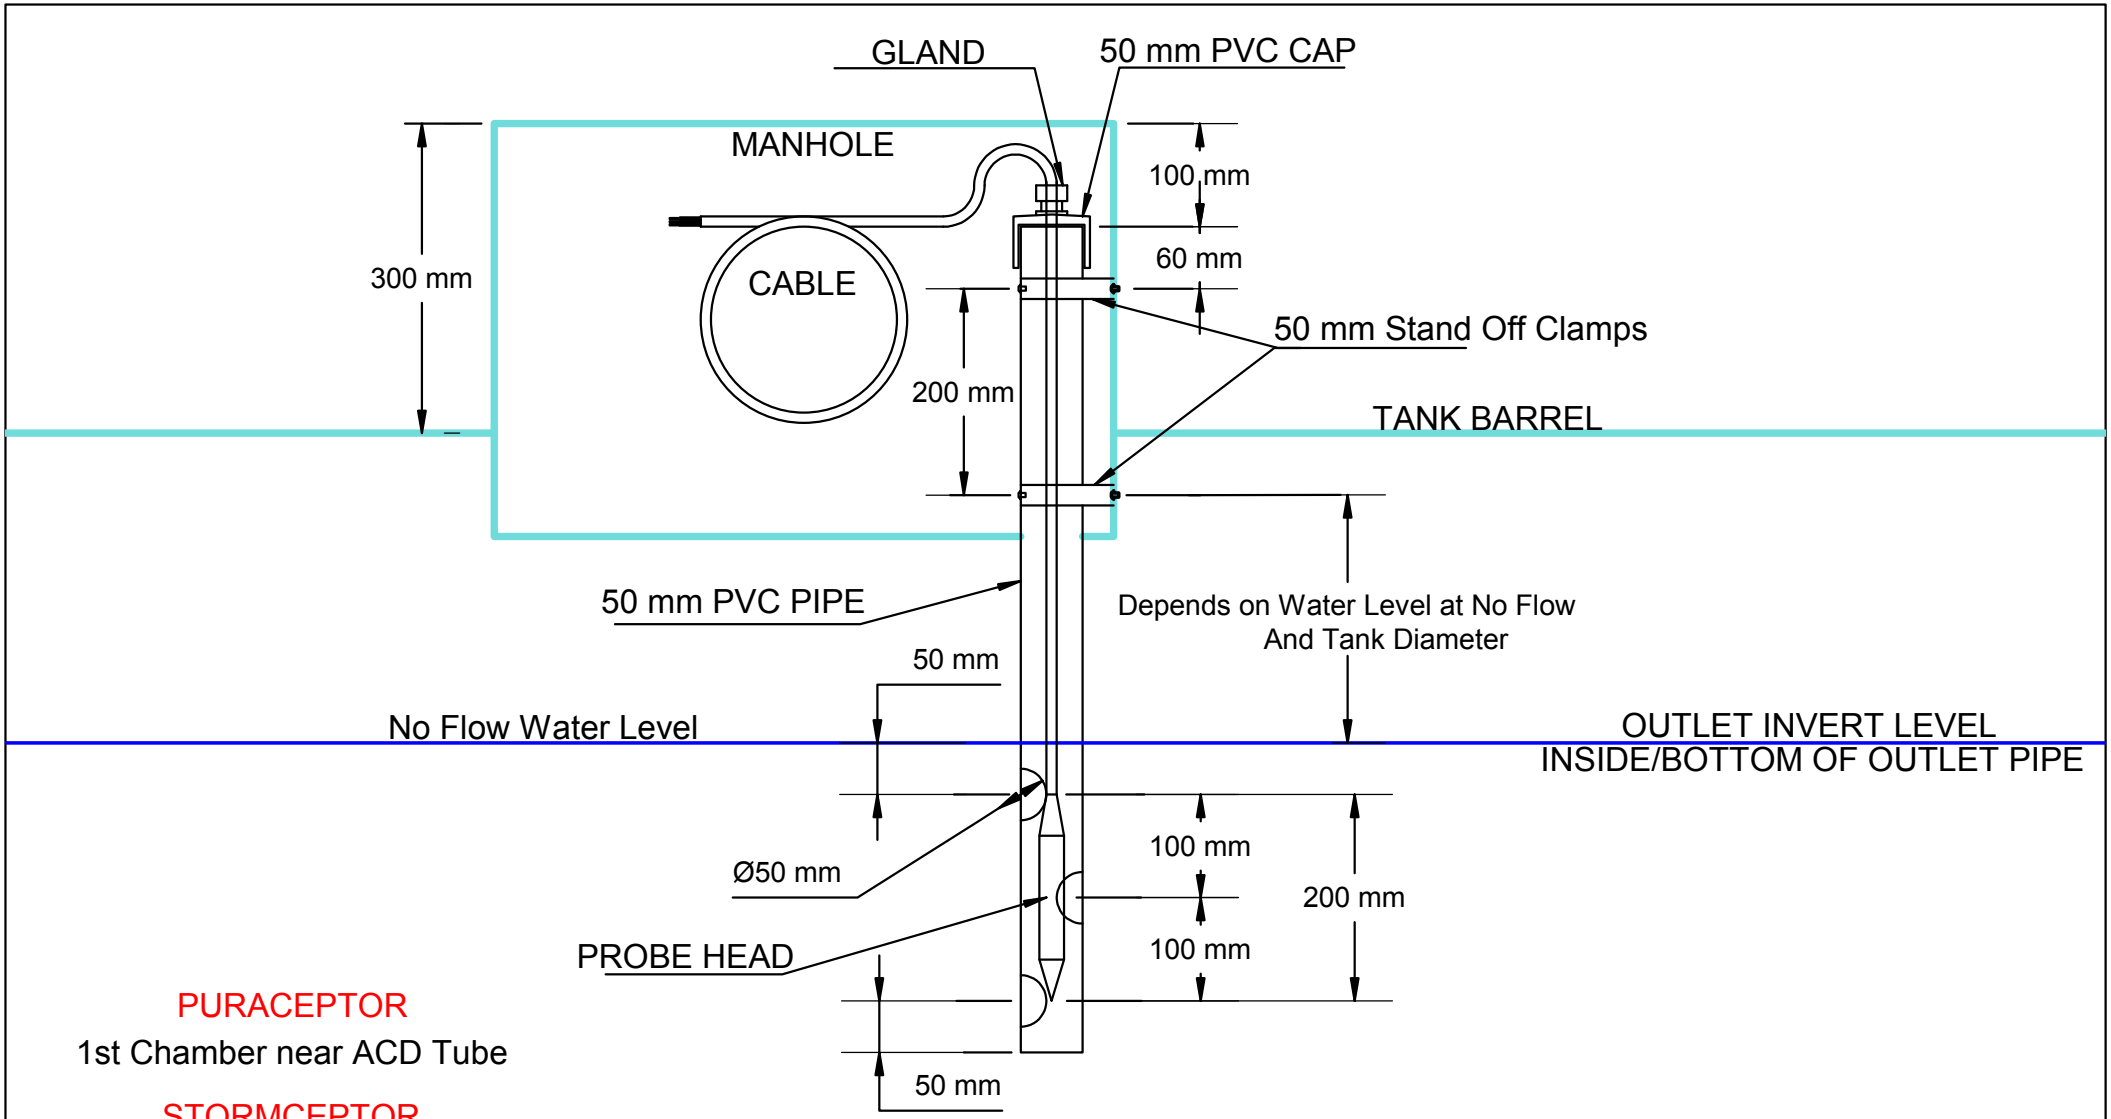

PURACEPTOR

1st Chamber near ACD Tube

STORMCEPTOR

2nd Chamber near Coalescer

DATE	REVISED	BY

SPEL ENVIRONMENTAL
STORMCEPTOR™ PURACEPTOR™

STORMWATER QUALITY IMPROVEMENT DEVICE

83 - 87 FENNELL ST. PARRAMATTA.
NSW. 2150.
PH: + 61 2 8838 1000.
FAX: + 61 2 9630 0369.
EMAIL: jl.nsw@spelproducts.com.au

TITLE:

SPEL OilSET 1000 Probe Setting

SIZE	CODE	DWG No:	REV
A4	EN 858-1	SO1PS	0

SCALE	DRAWN BY:	SHEET
NTS	JL	1 of 1
	DATE: 14.07.09	